

AUXILIARY SWITCH BLOCK, 32E, 2NO+2NC,  
DIN EN 50012, CAGE CLAMP CONNECTION,  
FOR CONTACTORS FOR SWITCHING MOTORS,  
4-POLE

### Auxiliary circuit:

#### Number of NC contacts / for auxiliary contacts

- instantaneous switching

2

#### Number of NO contacts / for auxiliary contacts

- instantaneous switching

2

#### Operating current / of the auxiliary contacts / at AC-15

- at 230 V

A

6

### Installation/mounting/dimensions:

#### Type of mounting

snap-on mounting

### Connections:

#### Design of the electrical connection

- for auxiliary and control current circuit

spring-loaded terminals

### Certificates/approvals:

#### General Product Approval

#### Functional Safety / Safety of Machinery

#### Declaration of Conformity



CCC



CSA



GOST



UL

[Type Examination](#)



EG-Konf.

#### Test Certificates

#### Shipping Approval

[Special Test  
Certificate](#)



ABS



GL



LRS



RINA



RMRS

#### other

[other](#)

[Environmental  
Confirmations](#)

### Further information:

#### Information- and Downloadcenter (Catalogs, Brochures,...)

<http://www.siemens.com/industrial-controls/catalogs>

---

**Industry Mall (Online ordering system)**  
<http://www.siemens.com/industrial-controls/mall>

---

**Cax online generator:**  
<http://www.siemens.com/cax>


---

**Service&Support (Manuals, Certificates, Characteristics, FAQs,...)**  
<http://support.automation.siemens.com/WW/view/en/3RH1911-2HA22/all>

---

**Image database (product images, 2D dimension drawings, 3D models, device circuit diagrams, ...)**  
[http://www.automation.siemens.com/bilddb/cax\\_en.aspx?mlfb=3RH1911-2HA22](http://www.automation.siemens.com/bilddb/cax_en.aspx?mlfb=3RH1911-2HA22)

---

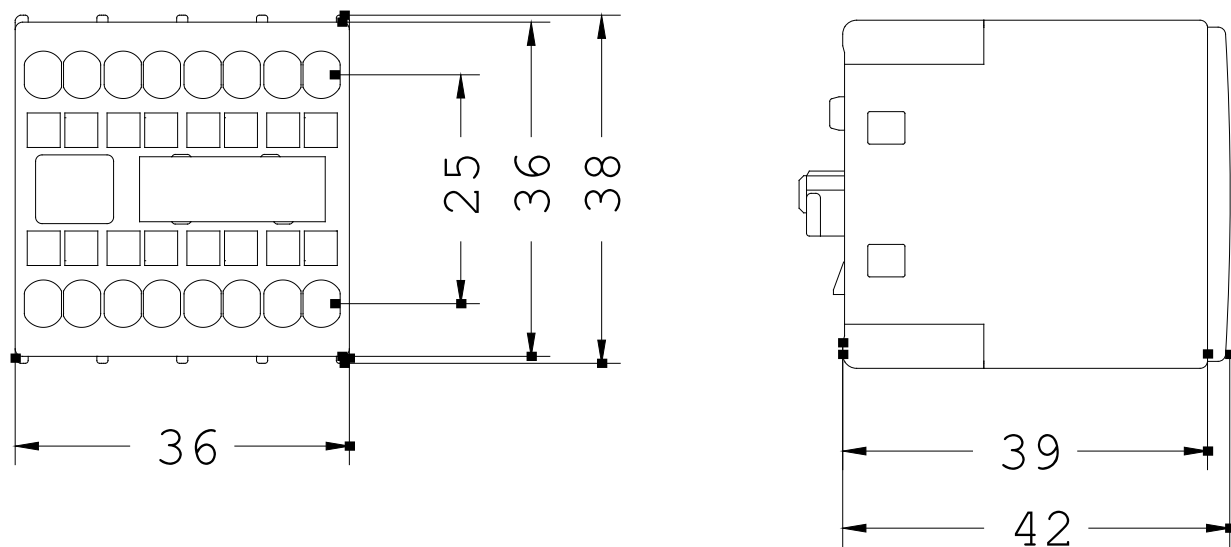

**last change:**

Sep 10, 2012