

MOUNTING BLOCK DIN EN 50005,  
4-POLE,2NO+2NC

### Auxiliary circuit:

#### Number of NC contacts / for auxiliary contacts

- instantaneous switching

2

#### Number of NO contacts / for auxiliary contacts

- instantaneous switching

2

#### Operating current / of the auxiliary contacts / at AC-15

- at 230 V

A

6

### Installation/mounting/dimensions:

#### Type of mounting

snap-on mounting

### Connections:

#### Design of the electrical connection

- for auxiliary and control current circuit

screw-type terminals

### Certificates/approvals:

#### General Product Approval

Functional Safety /  
Safety of  
Machinery

Declaration of  
Conformity



CCC



CSA



GOST



UL

[Type Examination](#)



EG-Konf.

#### Test Certificates

[Special Test  
Certificate](#)

[Type Test  
Certificates/Test  
Report](#)

#### Shipping Approval



ABS



BUREAU  
VERITAS



GL



LRS



RINA



RMRS

#### other

[Environmental  
Confirmations](#)

### Further information:

---

**Information- and Downloadcenter (Catalogs, Brochures,...)**

<http://www.siemens.com/industrial-controls/catalogs>

---

**Industry Mall (Online ordering system)**

<http://www.siemens.com/industrial-controls/mall>

---

**Cax online generator:**

<http://www.siemens.com/cax>

---

**Service&Support (Manuals, Certificates, Characteristics, FAQs,...)**


<http://support.automation.siemens.com/WW/view/en/3RH1921-1FA22/all>

---

**Image database (product images, 2D dimension drawings, 3D models, device circuit diagrams, ...)**

[http://www.automation.siemens.com/bilddb/cax\\_en.aspx?mlfb=3RH1921-1FA22](http://www.automation.siemens.com/bilddb/cax_en.aspx?mlfb=3RH1921-1FA22)

---

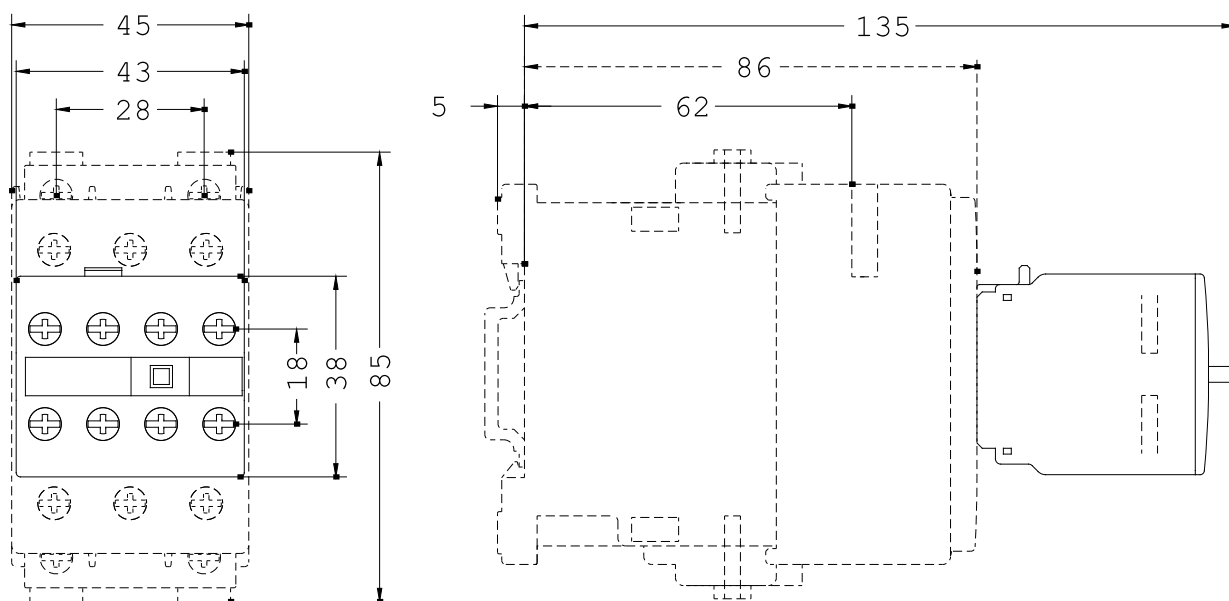

**last change:**

Sep 10, 2012