



### Main

Range of product	Zelio Control
Product or component type	Industrial measurement and control relays
Relay type	Voltage measurement relay
Relay name	RM4U
Relay monitored parameters	Overvoltage or undervoltage detection
Time delay	Adjustable 0.05...30 s
Power consumption in VA	1.9...3.3 VA AC
Measurement range	30...300 V voltage AC 50/60 Hz 30...300 V voltage DC 50...500 V voltage AC 50/60 Hz 50...500 V voltage DC
Electrical connection	2 conductors cable 1.5 mm <sup>2</sup> flexible cablewith cable end conforming to IEC 60947-1 2 conductors cable 2.5 mm <sup>2</sup> flexible cablewithout cable end conforming to IEC 60947-1
Contacts type and composition	2 C/O

### Complementary

[Us] rated supply voltage	110...130 V AC 50/60 Hz
Output contacts	2 C/O
Internal input resistance	1111000 Ohm 11110000 Ohm 668000 Ohm
Permissible continuous overload	400 V 550 V
Permissible non repetitive overload	500 A for ≤ 1 s 550 A for ≤ 1 s
Setting accuracy of the switching threshold	+/-5 %
Switching threshold drift	≤ 0.06 % per degree centigrade depending permissible ambient air temperature ≤ 0.5 % within the supply voltage range (0.85...1.1 Un)
Setting accuracy of time delay	10 P
Time delay drift	≤ 0.07 % per degree centigrade depending on the rated operational temperature ≤ 0.5 % within the supply voltage range (0.85...1.1 Un)
Hysteresis	5...30 % adjustable of voltage threshold setting
Marking	CE : EMC 89/336/EEC CE : LVD 73/23/EEC
Overvoltage category	III conforming to IEC 60664-1
[Ui] rated insulation voltage	500 V conforming to IEC
Operating voltage tolerance	0.85...1.1 Uc
Supply frequency	50/60 Hz +/- 5 %
Supply disconnection value	> 0.1 Uc
Operating position	Any position without derating
Tightening torque	0.6...1.1 N.m
Mechanical durability	30000000 cycles
[Ith] conventional free air thermal current	8 A

The information provided in this documentation contains general descriptions and/or technical characteristics of the performance of the products contained herein. This documentation is not intended as a substitute for and is not to be used for determining suitability or reliability of these products for specific user applications. It is the duty of any such user or integrator to perform the appropriate and complete risk analysis, evaluation and testing of the products with respect to the relevant specific application or use thereof. Neither Schneider Electric Industries SAS nor any of its affiliates or subsidiaries shall be responsible or liable for misuse of the information contained herein.


[le] rated operational current	2 A at 24 V DC-13 70 °C conforming to IEC 60947-5-1/1991 2 A at 24 V DC-13 70 °C conforming to VDE 0660 3 A at 115 V AC-15 70 °C conforming to IEC 60947-5-1/1991 3 A at 115 V AC-15 70 °C conforming to VDE 0660 3 A at 24 V AC-15 70 °C conforming to IEC 60947-5-1/1991 3 A at 24 V AC-15 70 °C conforming to VDE 0660 3 A at 250 V AC-15 70 °C conforming to IEC 60947-5-1/1991 3 A at 250 V AC-15 70 °C conforming to VDE 0660 0.1 A at 250 V DC-13 70 °C conforming to IEC 60947-5-1/1991 0.1 A at 250 V DC-13 70 °C conforming to VDE 0660 0.3 A at 115 V DC-13 70 °C conforming to IEC 60947-5-1/1991 0.3 A at 115 V DC-13 70 °C conforming to VDE 0660
Switching capacity in mA	10 mA at 12 V
Switching voltage	<= 440 V AC 250 V AC
Contacts material	90/10 silver nickel contacts
Number of cables	2
Height	78 mm
Width	22.5 mm
Depth	80 mm
Terminals description ISO n°1	(15-16-18)OC (25-26-28)OC (A1-A2)CO (C-B2-B3)CO
Output relay state	Tripped if A measured > A set
9 mm pitches	2.5
Product weight	0.168 kg

## Environment

Standards	EN/IEC 60255-6
Product certifications	CSA GL UL
Ambient air temperature for storage	-40...85 °C
Ambient air temperature for operation	-20...65 °C
Relative humidity	15...85 % 3K3 conforming to IEC 60721-3-3
Vibration resistance	0.35 ms (f = 10...55 Hz) conforming to IEC 60068-2-6
Shock resistance	15 gn for 11 ms conforming to IEC 60068-2-27
IP degree of protection	IP20 (terminals) conforming to IEC 60529 IP50 (casing) conforming to IEC 60529
Pollution degree	3 conforming to IEC 60664-1
Dielectric test voltage	2.5 kV
Non-dissipating shock wave	4.8 kV
Resistance to electrostatic discharge	6 kV contact conforming to IEC 61000-4-2 level 3 8 kV air conforming to IEC 61000-4-2 level 3
Resistance to electromagnetic fields	10 V/m conforming to IEC 61000-4-3 level 3
Resistance to fast transients	2 kV conforming to IEC 61000-4-4 level 3
Protection against electric shocks	2 kV conforming to IEC 61000-4-5 level 3
Disturbance radiated/conducted	CISPR11 group 1- class A CISPR22 - class A
RoHS EUR status	Compliant
RoHS EUR conformity date	0627

Voltage Measurement Relays

Dimensions

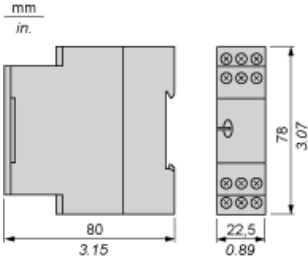


---


Voltage Measurement Relays

---

Rail mounting

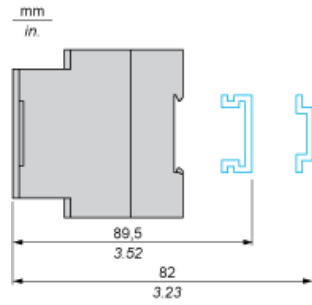


Screw fixing

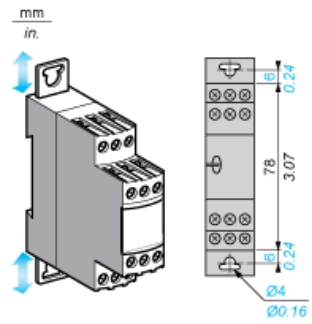

Voltage Measurement Relays


RM4UA01 and RM4UA02 Wiring Diagram



- A1- Supply voltage
- A2
- B1, Voltages to be measured (see table below)
- B2,
- B3, C

Connection and current values to be measured		
RM4UA•1	B1-C	0.05...0.5 V
	B2-C	0.3...3 V
	B3-C	0.5...5 V
RM4UA•2	B1-C	1...10 V
	B2-C	5...50 V
	B3-C	10...100 V


RM4UA03 Wiring Diagram



- A1- Supply voltage
- A2
- B2, Voltages to be measured (see table below)
- B3, C

Connection and current values to be measured	
B2-C	30...300 V
B3-C	50...500 V


RM4UA31 and RM4UA32 Wiring Diagram



- A1- Supply voltage
- A2
- B1, Voltages to be measured (see table below)
- B2,
- B3, C

Connection and current values to be measured		
RM4UA*1	B1-C	0.05...0.5 V
B2-C	0.3...3 V	
B3-C	0.5...5 V	
RM4UA*2	B1-C	1...10 V
B2-C	5...50 V	
B3-C	10...100 V	

### RM4UA33 Wiring Diagram



A1- Supply voltage

A2

B2, Voltages to be measured (see table below)


B3, C

Connection and current values to be measured	
B2-C	30...300 V
B3-C	50...500 V

### Voltage Measurement Relays

#### Application Scheme

Example: overspeed monitoring (undervoltage function)

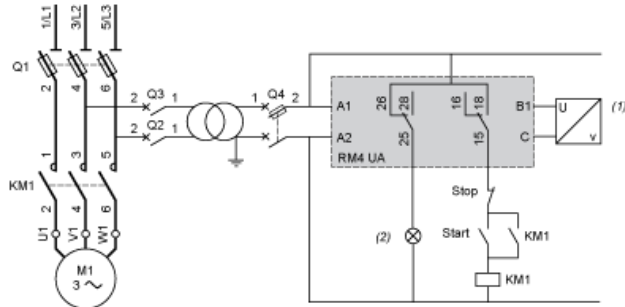


(1) Tachogenerator

(2) Overspeed

Electrical Durability and Load Limit Curves


AC Load

Curve 1: Electrical durability of contacts on resistive load in millions of operating cycles

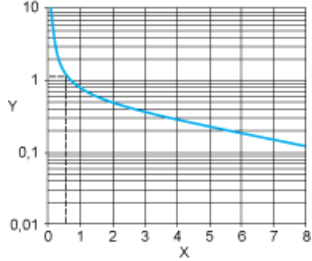

X Current broken in A  
Y Millions of operating cycles

Curve 2: Reduction factor k for inductive loads (applies to values taken from durability Curve 1)

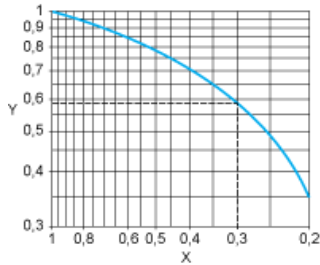

X Power factor on breaking (cos φ)  
Y Reduction factor K

Example: An LC1-F185 contactor supplied with 115 V/50 Hz for a consumption of 55 VA or a current consumption equal to 0.5 A and cos φ = 0.3.

For 0.5 A, curve 1 indicates a durability of approximately 1.5 million operating cycles.

As the load is inductive, it is necessary to apply a reduction coefficient k to this number of cycles as indicated by curve 2.


For cos φ = 0.3: k = 0.6

The electrical durability therefore becomes:


$$1.5 \times 10^6 \text{ operating cycles} \times 0.6 = 900\,000 \text{ operating cycles}$$

DC Load

Load limit curve

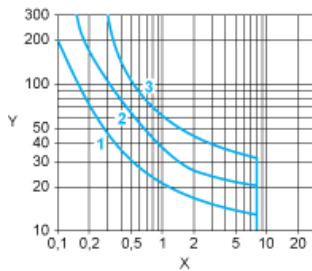

X Current in A  
Y Voltage in V  
1 L/R = 20 ms  
2 L/R with load protection diode  
3 Resistive load




---

## Function Diagram

---

### Overvoltage Control

Function ">"

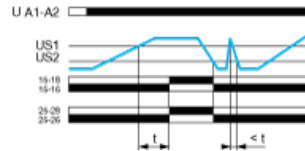

t Time delay  
U Supply voltage

A1-

A2

US1 Setting voltage threshold

US2 Voltage measured

15-18 Output relays connections (refer to Connections and Schema)

15-16;

25-28,

25-26

Relay status: black color = energized.

NOTE: Hysteresis is adjustable between 5 and 30%: for overvoltage  $h = (US1 - US2) / US1$ . A measuring cycle lasts only 80 ms, which allows rapid detection of changes in current.

NOTE: The measurement ranges can be extended above 500 V by adding a resistor. The measurement range on AC supply can be extended by means of a voltage transformer, the secondary of which is connected to the measuring terminals of the corresponding RM4.


---

## Function Diagram

---

### Undervoltage Control

Function "<"

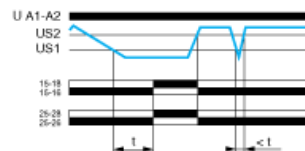

t Time delay  
U Supply voltage

A1-

A2

US1 Setting voltage threshold

US2 Voltage measured

15-18 Output relays connections (refer to Connections and Schema)

15-16;

25-28,

25-26

Relay status: black color = energized.

NOTE: Hysteresis is adjustable between 5 and 30%: for undervoltage  $h = (US2 - US1) / US1$ . A measuring cycle lasts only 80 ms, which allows rapid detection of changes in current.

NOTE: The measurement ranges can be extended above 500 V by adding a resistor. The measurement range on AC supply can be extended by means of a voltage transformer, the secondary of which is connected to the measuring terminals of the corresponding RM4.